


# Stopseal Linear Gap Seal

## Technical Data Sheet

UIC of product-type: LGS

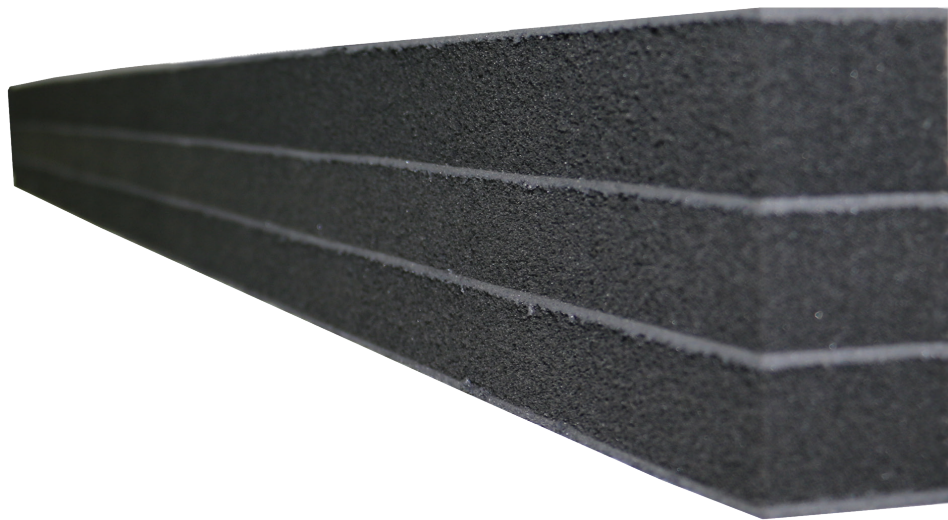

APPROVED  
CF507

FSi Limited  
Westminster Industrial Estate  
Tamworth Road  
Measham  
DE12 7DS  
UK

[www.fsilttd.com](http://www.fsilttd.com)  
Email: [technical@fsilttd.com](mailto:technical@fsilttd.com)  
Tel: +44 (0) 1530 515130  
Fax: +44 (0) 1530 273564





# Contents

Contents	Page
• Product Technical Data	1 - 2
- Product Overview	
• Performance Data - Walls	3
- 150mm Rigid wall	
• Performance Data - Floors	4
- 150mm Rigid Floor	



# Product Technical Data

## Product Overview

### Technical Description of the Product

Stopseal Linear Gap Seal is an elastomeric foam laminated with a graphite based intumescent layers. It is designed to perform as a 2 hour barrier in construction movement joints and is tested to EN 1366-4 and BS476. Stopseal Linear Gap Seal is designed for linear use between rigid horizontal and vertical fire resistant structural elements.

Stopseal Linear Gap Seal is a flexible product that expands when exposed to heat to prevent the passage of fire from one compartment to another. It can also be used as a fire barrier inside cable trunkings allowing for the installation of further cables.

### Key Product Points

- Fire resistance testing to EN 1366-4 + A1 : 2010 E 120, EI 120 and BS476.
- Up to 120mins available.
- Certifire 3rd Party Certification CF 507.
- IET (IEE) 17th Edition Fire Stop Compliant to Regulation 527.1-3 - Electrical Installations.
- BS 7671-2008 Chapter 42 & 52 - Electrical Installations Fire Resistance.
- Acoustic Isolation to EN 10140 to 18dB.
- Air Permeability testing to EN 1026 to 600Pa - 100Pa 3.3/1.7 m<sup>3</sup>/h/m<sup>2</sup> with Flexi-Coat.
- Tested in Rigid Block Wall, Concrete and Masonary.
- Tested in Rigid Concrete Floors.
- Tested in Linear Joints up to 150mm wide.
- Tested with Cable Trunking.
- Joint movement capability of up to 50%.
- Highly flexible.
- Maintenance free.
- Halogen free, resists fungi and vermin.



# Product Technical Data

Description	Result	Test Standard
Colour	Black	
Density	75Kg/m <sup>3</sup>	
Fire Resistance (mins)	EI 120	BS 476 & EN 1366-4
Acoustic Performance	Acoustic Reduction up to 8Rw, 18DnTW	EN10140
Air Permeability	200Pa EN 1026 - 100Pa 1581/1590 m <sup>3</sup> /h/m <sup>2</sup> 600Pa EN 1026 - 100Pa 3.3/1.7 m <sup>3</sup> /h/m <sup>2</sup> <b>with FSi Flexi-Coat</b>	EN 1026
Expansion Ratio	1:20	
Maximum Size of Aperture	150mm	
Maximum Size of Seal	170mm (other sizes can be requested)	
LGS Length	1000mm	
Movement Capability	Compression - up to 75%, Extension - up to 50% depending on product size	
Expected Working Life	Life cycle of the building	
Once compressed LGS will return to original size		

## Installation

Ensure that the aperture and services in question are tested with Stopseal Linear Gap Seal and that the site conditions are within the application specification. Sufficient space needs to be present to allow for an acceptable installation method.

Measure the void to be filled to ensure the correct size of Stopseal Linear Gap Seal is being used.

Clean the surrounding area so that it is free from dust. For trunking boxes tie any loose cables so that they form a tight bunch.

Compress seal between fingers and press into place. Slide in to place to ensure a snug fit to the surrounding building element or trunking. Ensure that core recovers and edge of the seal is flush with the face of the joint.

Seal can be cut easily with a Stanley knife to give correct fitting length.



# Performance Data - Walls

## Substrates

The walls shall be a minimum of **150mm thick**. Masonry / Concrete walls shall have a minimum density for concrete or brick of 780kg/m<sup>3</sup> and for aerated concrete blocks of 600kg/m<sup>3</sup>. All walls shall have at least the same fire resistance as that required for the sealing system.

## RIGID WALL

Linear joints

Blockwork / Masonry / Concrete (aerated or normal) Wall installations with a minimum thickness of 150mm.				
Seal Ref.	Min. Joint Width mm	Max. Joint Width mm	Product Depth (mm)	Fire Resistance Performance (mins)
LGS10/2	5	10	12	120
LGS20/2	11	20	12	
LGS25/2	21	25	20	
LGS35/2	26	35	20	
LGS50/2	36	50	35	
LGS65/2	51	65	40	
LGS75/2	66	75	50	
LGS100/2	76	100	100	
LGS125/2	101	125	125	
LGS150/2	126	150	100	



# Performance Data - Floor

## Substrates

The floors shall be a minimum of **150mm thick**. Masonry / Concrete floors shall have a minimum density for concrete or brick of 780kg/m<sup>3</sup> and for aerated concrete blocks of 600kg/m<sup>3</sup>. All floors shall have at least the same fire resistance as that required for the sealing system.

## RIGID FLOOR

Linear joints

Blockwork / Masonry / Concrete (aerated or normal) Floor installations 150mm thick (min.)				
Seal Ref.	Min. Joint Width mm	Max. Joint Width mm	Product Depth (mm)	Fire Resistance Performance (mins)
LGS10/2	5	10	12	120
LGS20/2	11	20	12	
LGS25/2	21	25	20	
LGS35/2	26	35	20	
LGS50/2	36	50	35	
LGS65/2	51	65	40	
LGS75/2	66	75	50	
LGS100/2	76	100	100	
LGS125/2	101	125	125	
LGS150/2	126	150	100	

FSi has Technical Representatives who provide assistance in the selection and specification of FSi products. For more information, specification and technical advice please call our Head Office on Tel: +44 (0) 1530 515130. Guarantee / Warranty: FSi products are manufactured to rigid standards of quality. Any product which has been applied in accordance with FSi's written instructions and in any application recommended by FSi, but which is proved to be defective in product quality, will be replaced free of charge. No liability can be accepted for the information provided in this document although it is published in good faith and believed to be correct. FSi Limited reserves the right to alter product specifications without prior notice, in line with our Company policy of continuous development and improvement.